Solar inverter

358-010604-00

felicitysolar®

Make life full of hope

USER GUIDE

Solar Inverter

IVEM4024-II



Solar inverter

Contents

ABOUT THIS MANUAL.....01
Purpose.....01
Scope.....01
Safety instructions.....01
WARNING MARKS.....02
INTRODUCTION.....03
Features.....03
Basic system architecture.....03
PRODUCT OVERVIEW.....04
SPECIFICATIONS.....05
INSTALLATION.....08
Safety guidance.....08
Unpacking and inspection.....09
Preparation.....09
Mounting the unit.....09
Battery connection.....10
AC input /output connection.....11
PV connection.....13
Final assembly.....14
Dry contact signal.....14
Inverter and computer connection.....15
Wiring System for Inverter.....16
OPERATION.....**17**
Power ON/OFF.....17
Operation and display panel.....17
LCD display icons.....18
LCD operation flow chart.....20
Base information Page.....21
Setting Page.....23
Energy stored data Page.....31
BMS information Page.....32
Rated information Page.....33
Generator Port Use Setup Page.....33
Lithium Battery Communication.....34
Battery Equalization.....36
Warning Code Table.....37
Fault Code Table.....38
The Wi-Fi operation Guide in APP.....41
Introduction.....41
Download and install APP.....41

ABOUT THIS MANUAL

Purpose

This manual describes the assembly, installation, operation, warning code and fault code of this unit. Please read this manual carefully before installations and operations. Keep this manual for future reference.

Scope

This manual provides safety and installation guidelines as well as information on tools and wiring.

Safety instructions

WARNING: This chapter contains important safety and operating instructions. Read and keep this manual for future reference.

1. Before using the unit, read all instructions and cautionary markings on the unit, the batteries and all appropriate sections of this manual.
2. **CAUTION** --To reduce risk of injury, charge only deep-cycle lead acid type rechargeable batteries. Other types of batteries may burst, causing personal injury and damage.
3. Do not disassemble the unit. Take it to a qualified service center when service or repair is required. Incorrect re-assembly may result in a risk of electric shock or fire.
4. To reduce risk of electric shock, disconnect all wirings before attempting any maintenance or cleaning. Turning off the unit will not reduce this risk.
5. **CAUTION** – Only qualified personnel can install this device with battery.
6. **NEVER** charge a frozen battery.
7. For optimum operation of this inverter/charger, please follow required spec to select appropriate cable size. It's very important to correctly operate this inverter/charger.
8. Be very cautious when working with metal tools on or around batteries. A potential risk exists to drop a tool to spark or short circuit batteries or other electrical parts and could cause an explosion.
9. Please strictly follow installation procedure when you want to disconnect AC or DC terminals. Please refer to INSTALLATION section of this manual for the details.
10. Fuse is provided as over-current protection for the battery supply.
11. GROUNDING INSTRUCTIONS -This inverter/charger should be connected to a permanent grounded wiring system. Be sure to comply with local requirements and regulation to install this inverter.
12. NEVER cause AC output and DC input short circuited. Do NOT connect to the mains when DC input short circuits.
13. **Warning!!** Only qualified service persons are able to service this device. If errors still persist after following troubleshooting table, please send this inverter/charger back to local dealer or service center for maintenance.

WARNING MARKS

Warning marks inform users of conditions which can cause serious physical injury or death, or damage to the device. They also tell users how to prevent the dangers. The warning marks used in this operation manual are shown below:

Mark	Name	Instruction	Abbreviation
 Danger	Danger	Serious physical injury or even death may occur if not follow relevant requirements.	
 Warning	Warning	Physical injury or damage to the device may occur if not follow relevant requirements.	
 Forbid	Electrostatic sensitive	Damage may occur if relevant requirements are not followed.	
 Hot	High temperature	Do not touch the base of the inverter as it will become hot.	
Note	Note	The procedures taken for ensuring proper operation.	Note

INTRODUCTION

This is a multi-function inverter/charger, combining functions of inverter, MPPT solar charger and battery charger to offer uninterruptible power support with portable size. Its comprehensive LCD display offers user-configurable and easy-accessible button operation such as battery charging current, AC/solar charger priority, and acceptable input voltage based on different applications.

Features

- Wide PV voltage input range (60VDC-500VDC)
- Maximum PV input current increases to 27A.
- Battery charging power up to 120A
- Pure sine wave inverter
- Built-in MPPT solar charge controller
- Configurable input voltage range for home appliances and personal computers via LCD setting
- Configurable battery charging current based on applications via LCD setting
- Configurable AC/Solar Charger priority via LCD setting
- Compatible to mains voltage or generator power
- Auto restart while AC is recovering
- Overload / Over temperature/ short circuit protection
- Inverter running without battery
- Lithium battery activation function.
- Cold start function
- Built-in Wi-Fi for mobile monitoring (APP is required)
- The generator input port can be changed to a smart output port
- Control smart output port can customize output duration

Basic System Architecture

The following illustration shows basic application for this inverter/charger. It also includes following devices to have a complete running system:

- Generator or Utility.
- PV modules (option)

Consult with your system integrator for other possible system architectures depending on your requirements.

This inverter can power all kinds of appliances in home or office environment, including motor-type appliances such as tube light, fan, refrigerator and air conditioner.

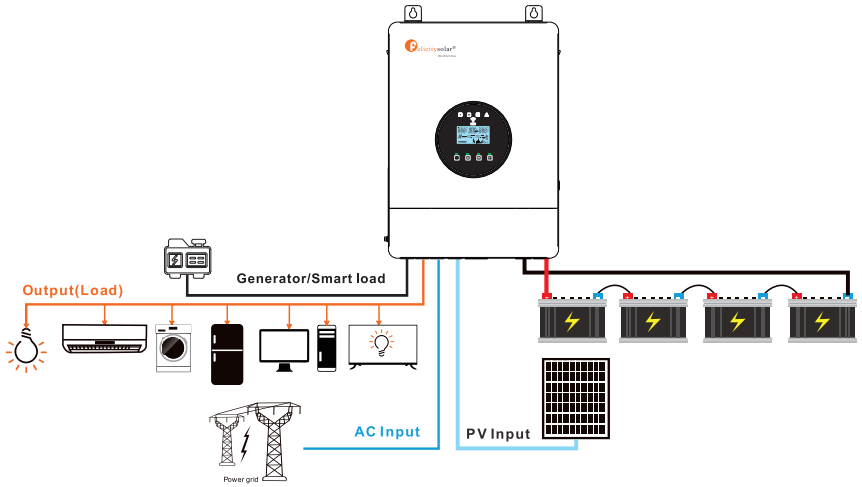

PRODUCT OVERVIEW

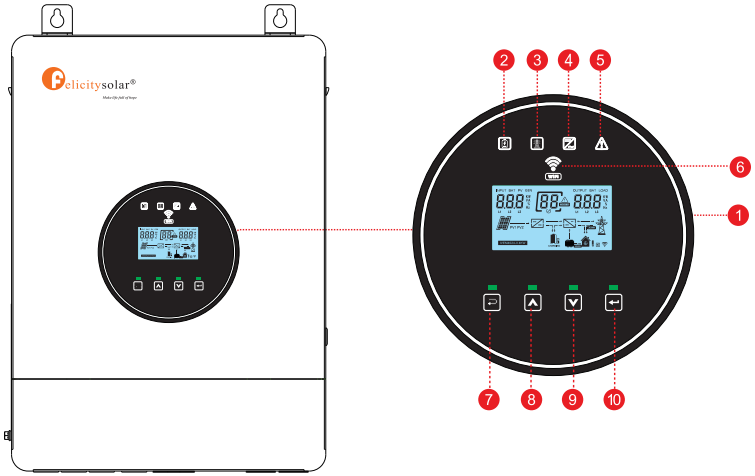

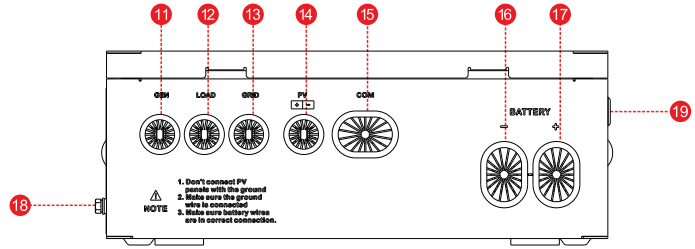

1. LCD display
2. Charging indicator
3. Utility bypass indicator
4. Inverter indicator
5. Fault or warning indicator
6. WIFI identifier
7. ESC button
8. UP button
9. DOWN button
10. ENTER button
11. GEN port
12. OUTPUT port
13. Grid
14. PV input connection port
15. Communication connection port
16. Battery negative-
17. Battery positive+
18. Grounding point
19. Power on/off

SPECIFICATIONS

Line Mode Specifications		
Model		**IVEM4024-II**
Rated Output Power		4000VA
		4000W
Nominal DC Input Voltage		24V
Input Voltage Waveform		Sinusoidal (utility or generator)
Nominal Input Voltage		230Vac
Low Line Voltage Disconnect		170Vac±7V (UPS); 90Vac±7V (Appliances)
Low Loss Voltage Re-connect		180Vac±7V (UPS); 100Vac±7V (Appliances)
High Line Voltage Disconnect		280Vac±7V
High Line Voltage Re-connect		270Vac±7V
Max AC Input Voltage		280Vac
Nominal Input Frequency		50Hz / 60Hz (Auto detection)
Low Line Frequency Disconnect		40±1Hz
Low Line Frequency Re-connect		42±1Hz
High Line Frequency Disconnect		65±1Hz
High Line Frequency Re-connect		63±1Hz
Output Voltage Waveform		As same as input waveform
Output Short Circuit Protection		Line mode: Circuit Breaker Battery mode: Electronic Circuits
Efficiency (Line Mode)		>93%(Rated R load, battery full charged)
Transfer Time (Single unit)		10ms typical (UPS); 20ms typical (Appliances)
Output power derating	When AC input voltage drops to 170V,the output power will be de-rated.	
	When DC input voltage drops to 25V,the output power will be de-rated.	
Pass Through Without Battery		Yes
Max. Bypass Overload Current		30A
Max. Inverter/Rectifier Current		30A/4000W

Utility Charge Mode Specifications	
Nominal Input Voltage	230Vac
Input Voltage Range	90~280Vac (For Home Appliances) ;180~280Vac (For Computers)
Nominal Output Voltage	Dependent on battery type
Max. Charge Current	120A
Charge Current Regulation	10-120A (Adjustable unit is 1A)
Over Charge Protection	Yes
Solar Charging & Grid Charging	
Max. PV Open Circuit Voltage	500V
PV Voltage Working Range	60V-500V
Max. Input Power	6000W
Max. Solar Charging Current	120A
Max. Charging Current(PV+Grid)	120A
Max. Input Current	27A
Min. Startup Voltage	60V

Charge Algorithm			
Algorithm	**Three stage:** Boost CC (Constant current stage) ->Boost CV (Constant voltage stage) ->Float (Constant voltage stage)		
Charging Curve	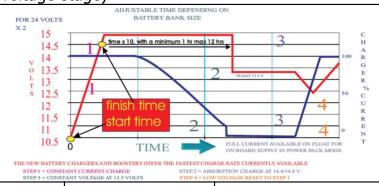		
Battery Type Setting	Battery Type	Boost CC/CV	Float
	AGM	28.2V	27V
	Flooded	29.2V	27V
	Self - defined	Adjustable, up to 30V	
	Lithium		

Inverter Mode Specifications	
Model	**IVEM4024-II**
Rated Output Power	4000VA
	4000W
Nominal DC Input Voltage	24V
Output Voltage Waveform	Pure sine wave
Nominal Output Voltage	230Vac±5%
Nominal Output Frequency (Hz)	50±0.3Hz/60Hz±0.3Hz (Adjustable)
Parallel capability	No
Peak Efficiency	93%
Over-Load Protection (SMPS load)	Load>200%,200ms / Load >150%,5.5s Load >120%,7.5s / Load >105% 10.5s
Surge Rating	2* rated power for 5s
Capable of Starting Electric	Yes
Output Short Circuit Protection	Yes
Cold Start Voltage	23V
Low Battery Alarm **Load < 50%** **@Load ≥ 50%**	22.5V 22.0V
Low Battery Alarm Recovery **Load < 50%** **@Load ≥ 50%**	23.5V 23.0V
Low DC Input Shut-down **Load < 50%** **@Load ≥ 50%**	21.5V 21.0V
High DC Input Alarm & Fault	31V±0.4V
High DC Input Recovery	30V±0.4V
General Specifications	
Operating Temperature	-10C°~50C°
Range Storage Temperature	-15C°~60C°
Net Weight (Kg)	10.4KG
Gross Weight (Kg)	11.9KG
Product Size (D*W*H)	430x310x120mm
Package Dimension (D*W*H)	507X387X197mm

INSTALLATION

Safety Guidance

Warning marks inform users of conditions which can cause serious physical injury or death, or damage to the device. They also tell users how to prevent the dangers. The warning marks used in this operation manual are shown below:

	● After receiving this product, first confirm the product package is intact. If any question, contact the logistic company or local distributor immediately. ● The installation and operation of inverter must be carried out by professional technicians who have received professional trainings and thoroughly familiar with all the contents in this manual and the safety requirements of the electrical system.
	● Do not carry out connection/disconnection, unpacking inspection and unit replacement operations on the inverter when power source is applied. Before wiring and inspection, users must confirm the breakers on DC and AC side of inverter are disconnected and wait for at least 5 minutes.
	● Ensure there is no strong electromagnetic interference caused by other electronic or electrical devices around the installation site. ● Do not refit the inverter unless authorized. ● All the electrical installation must conform to local and national electrical standards
	● Do not touch the housing of the inverter or the radiator to avoid scald as they may become hot during operation.
	● Ground with proper technics before operation.
	● Do not open the surface cover of the inverter unless authorized. The electronic components inside the inverter are electrostatic sensitive. Do take proper anti-electrostatic measures during authorized operation.
	● The inverter needs to be reliably grounded.
	● Ensure that DC and AC side circuit breakers have been disconnected and wait at least 5 minutes before wiring and checking.

Unpacking and Inspection

Before installation, please inspect the unit. Be sure that nothing inside the package is damaged. You should have received the following items inside of package:


Inevter unit x 1


Manual x 1


Expansion bolt x 2


Wall Hangers x 2 and Screws x 4


Cold pressed terminal x 2

Preparation

Before connecting all wirings, please take off bottom cover by removing four screws as shown below.

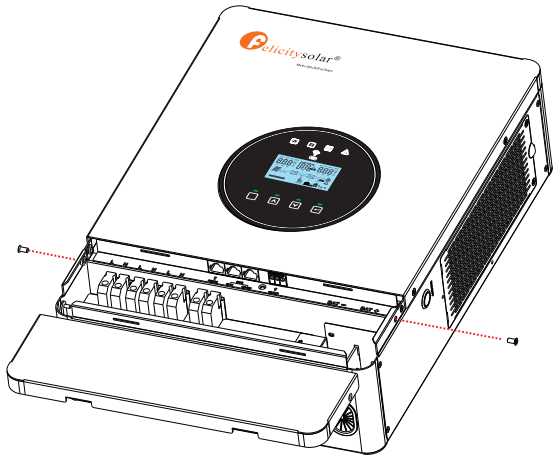

Mounting the Unit

Consider the following points before selecting where to install:

- Do not mount the inverter on flammable construction materials.
- Mount on a solid surface
- Install this inverter at eye level in order to allow the LCD display to be read at all times.
- The ambient temperature should be between 0°C and 55°C to ensure optimal operation.
- The recommended installation position is to be adhered to the wall vertically.
- Be sure to keep other objects and surfaces as shown in the right diagram to guarantee sufficient heat dissipation and to have enough space for removing wires.

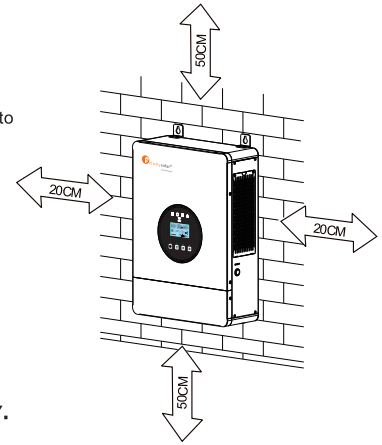

SUITABLE FOR MOUNTING ON CONCRETE OR OTHER NON-COMBUSTIBLE SURFACE ONLY.

Install the unit by screwing three screws. It's recommended to use M4 or M5 screws.

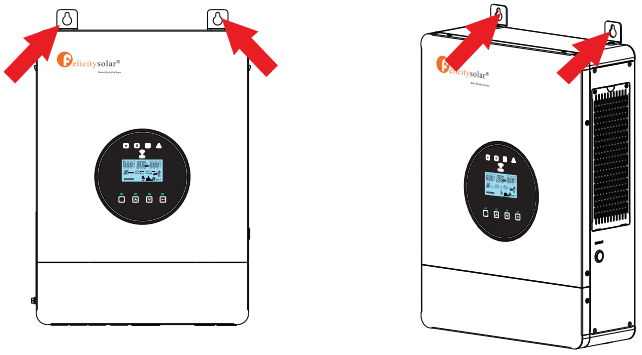

Battery Connection

CAUTION: For safety operation and regulation compliance, it's requested to install a separate DC over-current protector or disconnect device between battery and inverter. It may not be requested to have a disconnect device in some applications, however, it's still requested to have over-current protection installed. Please refer to typical amperage in below table as required fuse or breaker size.

WARNING! All wiring must be performed by a qualified personnel.
WARNING! It's very important for system safety and efficient operation to use appropriate cable for battery connection. To reduce risk of injury, please use the proper recommended cable and terminal size as below.

Recommended battery cable and terminal size:

Model	Wire Size	Cable (mm^2)	Torque Value(Max)
4KVA	1AWG	42	8.7Nm

Please follow below steps to implement battery connection:

1. Assemble battery ring terminal based on recommended battery cable and terminal size.
2. Connect all battery packs as units requires. It's suggested to connect at least 200Ah capacity battery.
3. Insert the ring terminal of battery cable flatly into battery connector of inverter and make sure the bolts are tightened with torque of 2 Nm. Make sure polarity at both the battery and the inverter/charge is correctly connected and ring terminals are tightly screwed to the battery terminals.

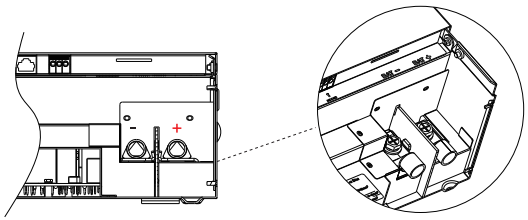

⚠	**WARNING: Shock Hazard** Installation must be performed with care due to high battery voltage in series.

⚠	**CAUTION!!** Do not place anything between the flat part of the inverter terminal and the ring terminal. Otherwise, overheating may occur. **CAUTION!!** Do not apply anti-oxidant substance on the terminals before terminals are connected tightly. **CAUTION!!** Before making the final DC connection or closing DC breaker/disconnector, be sure positive (+) must be connected to positive (+) and negative (-) must be connected to negative (-).

AC Input/Output Connection

⚠ **CAUTION!!** Before connecting to AC input power source, please install a separate AC breaker between inverter and AC input power source. This will ensure the inverter can be securely disconnected during maintenance and fully protected from over current of AC input. The recommended spec of AC breaker is 50A for 4KVA.

⚠ **CAUTION!!** There are two terminal blocks with "IN" and "OUT" markings. Please do NOT mis-connect input and output connectors.

WARNING! All wiring must be performed by qualified personnel.

WARNING! It's very important for system safety and efficient operation to use appropriate cable for AC input connection. To reduce risk of injury, please use the proper recommended cable size as below.

Suggested cable requirement for AC wires

Model	Gauge	Cable (mm^2)	Torque Value
4KVA	8 AWG	6	1.6Nm

Please follow below steps to implement AC input/output connection:

1.Before making AC input/output connection, be sure to open DC protector or disconnector first.

2.Remove insulation sleeve 10mm for six conductors. And shorten phase L and neutral conductor N 3 mm.

3. Insert AC input wires according to polarities indicated on terminal block and tighten the terminal screws. Be sure to connect PE protective conductor (⏚) first.

⏚→**Ground (yellow-green)**

L→LINE (brown or black)

N→Neutral (blue)



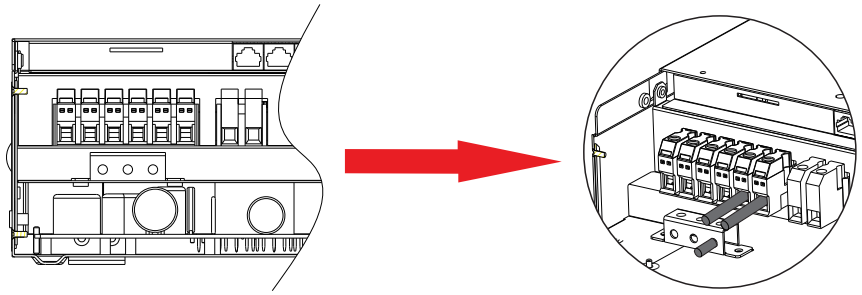

⚠	**WARNING:** Be sure that AC power source is disconnected before attempting to hardwire it to the unit.

4. Generator interface operation
The generator interface has two multiplexing modes: generator input and smart load output. The default is input mode. If you want to switch to output mode, refer to the "LCD Settings" section for details
Insert AC output / AC input wires according to polarities indicated on terminal block and tighten terminal screws.

Be sure to connect PE protective conductor(⏚) first.

⏚→**Ground (yellow-green)**

L→LINE (brown or black)

N→Neutral (blue)



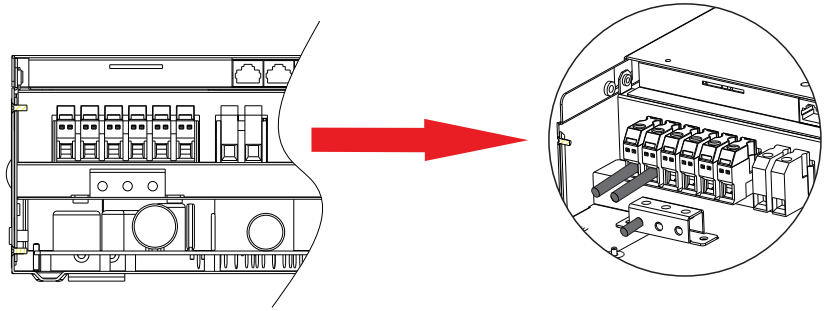

5. Insert AC output wires according to polarities indicated on terminal block and tighten terminal screws.

Be sure to connect PE protective conductor(⏚) first.

⏚→**Ground (yellow-green)**

L→LINE (brown or black)

N→Neutral (blue)



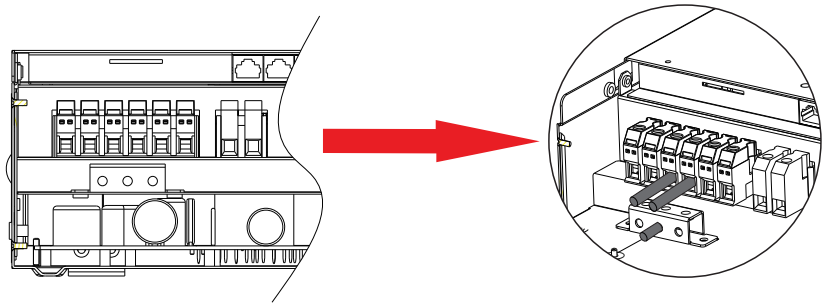

6. Make sure the wires are securely connected.

CAUTION: Important
Be sure to connect AC wires with correct polarity. If L and N wires are connected reversely, it may cause utility short-circuited when these inverters are worked in parallel operation.

CAUTION: Appliances such as air conditioner are required at least 2~3 minutes to restart because it's required to have enough time to balance refrigerant gas inside of circuits. If a power shortage occurs and recovers in a short time, it will cause damage to your connected appliances. To prevent this kind of damage, please check manufacturer of air conditioner if it's equipped with time-delay function before installation. Otherwise, this inverter/charger will trig overload fault and cut off output to protect your appliance but sometimes it still causes internal damage to the air conditioner.

PV Connection

CAUTION: Before connecting to PV modules, please install separately a DC circuit breaker between inverter and PV modules.

WARNING! All wiring must be performed by qualified personnel.

WARNING! It'' very important for system safety and efficient operation to use appropriate cable for PV module connection. To reduce risk of injury, please use the proper recommended cable size as below.

Model	Cable Size	Cable (mm^2)	Torque
4KVA	10~12 AWG	4~6	1.6 Nm

Warning: Inverter accepts: single crystal, polycrystal with Class A rating and CIGS module because it is non-isolated.To prevent the fault, do not connect the PV modules that may leak current to the inverter. For instance, when using the PV module, ensure that there is no grounding connection.Because Grounded PV modules can cause leakage current in the inverter.

PV Module Selection:

When selecting proper PV modules, please be sure to consider below parameters:

1.Open circuit Voltage (Voc) of PV modules not exceeds max. PV array open circuit voltage of inverter.

2.Max. power voltage (Vmp) should be during PV array MPPT voltage range.

Solar Charging Mode	
INVERTER MODEL	4KVA
Max. PV Array Open Circuit Voltage	500V
PV Array MPPT Voltage Range	60Vdc~430Vdc

Please follow below steps to implement PV module connection:

1.Remove insulation sleeve 10 mm for positive and negative conductors.

2.Check correct polarity of connection cable from PV modules and PV input



connectors. Then, connect positive pole (+) of connection cable to positive pole (+) of PV input connector. Connect negative pole (-) of connection cable to negative pole (-) of PV input connector.

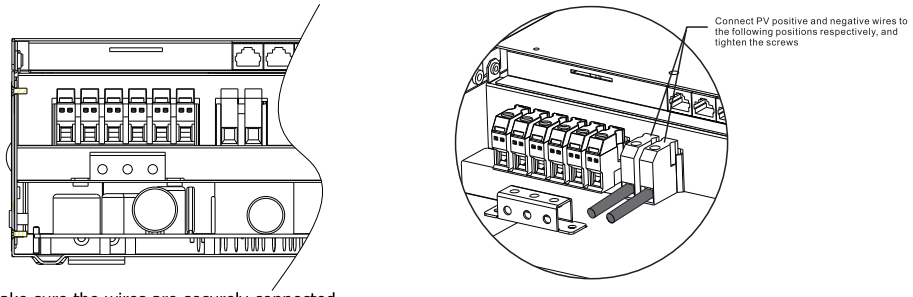

3. Make sure the wires are securely connected.

Final Assembly

After connecting all wirings, please put bottom cover back by screwing two screws as shown below.

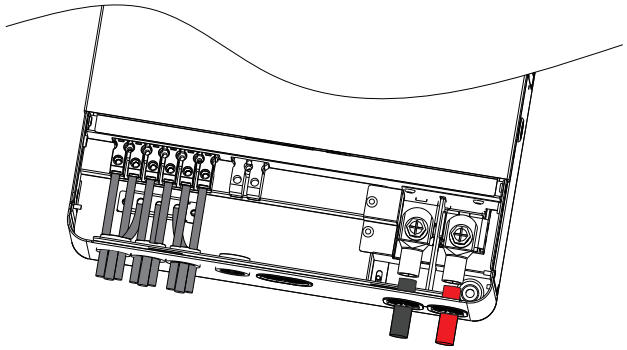

Dry Contact

There is one dry contact (3A/250VAC) available on the inverter.

Unit Status	Condition	Dry contact port: NC C NO	
		NC & C	NO & C
Power Off	Unit is off and no output is powered.	Close	Open
Power On	Battery voltage < Setting value in Program 12	Open	Close
	Battery voltage > Setting value in Program 13 or battery charging reaches floating stage	Close	Open

Inverter and computer connection

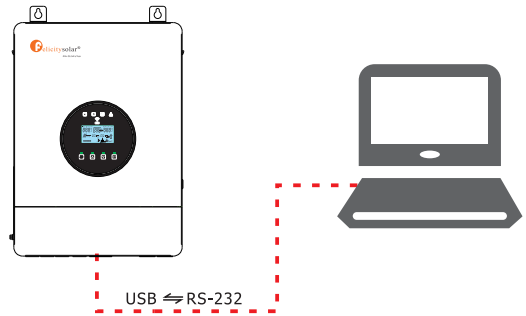

Pin Assignment for RS232 Communication Port

	PIN 1	PIN 2	PIN 3	PIN 4	PIN 5	PIN 6	PIN 7	PIN 8	
RS232	RS232TX	RS232RX	+12V	GND	NC	NC	NC	GND	

*If you need to update the firmware library, please contact after-sales personnel

Wiring System for Inverter

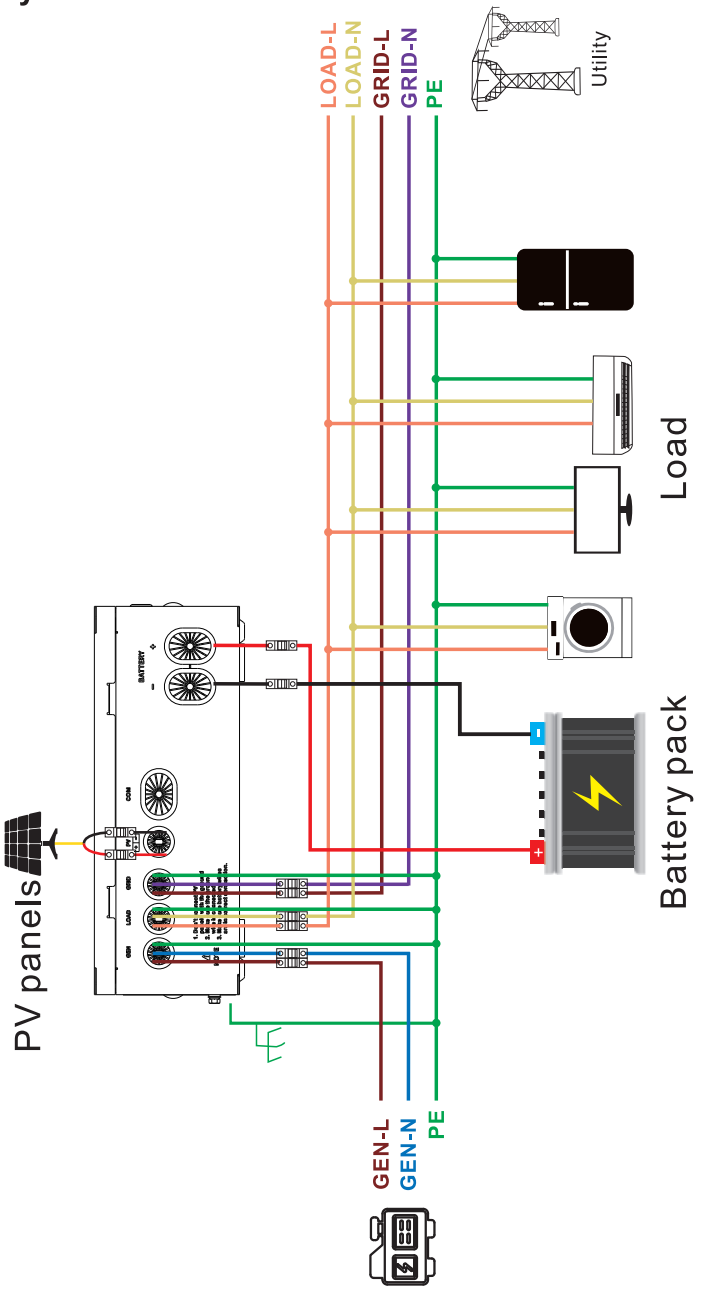

NOTE 1: The power grid N line and off grid N line cannot be shared and connected independently

OPERATION

Power ON/OFF

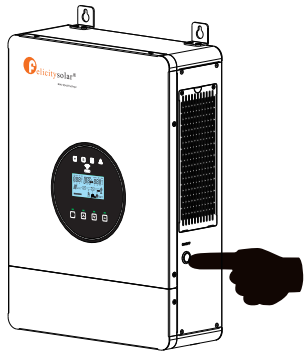

Once the unit has been properly installed and the batteries are connected well, simply press On/Off switch(located on the bottom of the case) to turn on the unit.

Operation and Display Panel

The operation and display panel, shown in below chart, is on the front panel of the inverter. it includes fourindicators, four function keys and a LCD displav, indicating the operating status and input/output power information.



Function Key	Icon	Description
ESC		To previous page
UP		To go to previous selection
DOWN		To go to next selection
ENTER		To confirm the selection or go to next page

LED Indicator	Icon	Color	State	Descirption
Battery		Green	solid	The battery is charging, approaching saturation
			Flashing	The battery is charging.
			dim	The battery is not charged.
Utility		Green	solid	Inverter is running in utility mode.
			dim	Inverter is not running in utility mode.
Inverter		Green	solid	Inverter is running in off-grid mode.
			dim	Inverter is not running in off-grid mode.
Fault		Red	solid	Inverter works in fault event.
			Flashing	Inverter works in warning event.
			dim	Inverter works normally.
Buzzer Information				
Buzzer beep	Turn on/off the inverter, the buzzer will last for 2.5s. Press any button, the buzzer will last for 0.1s. Hold on the "ENTER" button, the buzzer will last for 3s. If in fault event, the buzzer will keep going. If in warning event, the buzzer will beep discontinuous (Check more information on the chapter of "Warning Code Table").			

LCD Display Icons

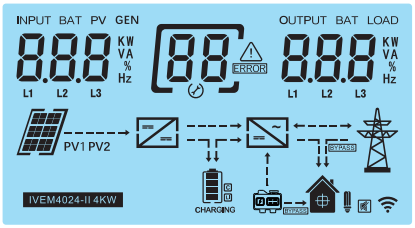

Icon	Function description
Input Source Information	
	Indicate input voltage, input frequency, PV voltage, PV power, battery voltage and charger current.
Configuration Program and Fault Information	
	Indicates the setting programs.
	Indicates the warning and fault codes. Warning:  flashing with warning code. Fault:  lighting with fault code

Output Information	
OUTPUT BAT LOAD 8.8.8 KW VA % Hz	Indicate output voltage, output frequency, load percent, load in VA, load in Watt and discharging current.
Battery Information	
	Indicates battery level by 0-24%, 25-49%, 50-74% and 75-100%.
	Indicates Lithium battery type.
	Indicates communication is built between inverter and battery.
Mode Operation Information	
	Indicates the utility.
BYPASS	Indicates load is supplied by utility directly.
	Indicates the inverter/charger is working.
	Indicates the PV panels.
	Indicates PV MPPT is working.
	Indicates the WIFI link
	Indicates the first AC output
	Indicates the second AC output
	Indicates the generator input
Mute Operation	
	Indicates unit alarm is disabled.

LCD operation flow chart

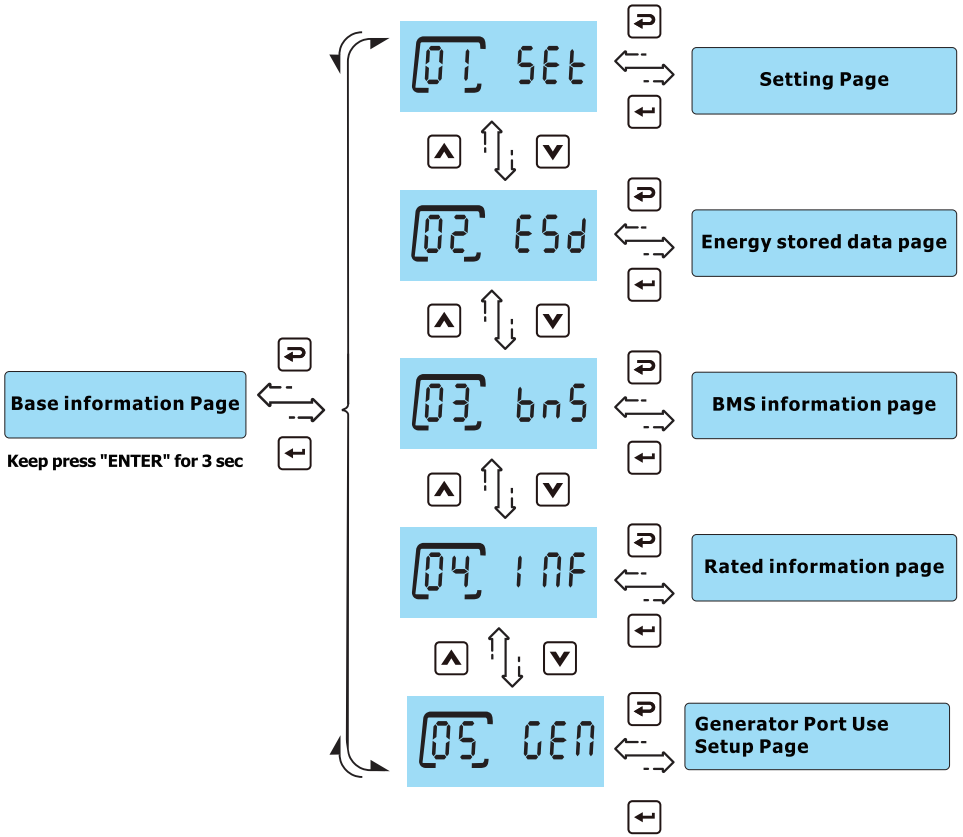

On base information page, pressing and holding "ENTER" key for 3 sec, the unit will enter parameters page. Press "UP" or "DOWN" key to switch the selection and press "ENTER" key to enter selected page. Press "ESC" key to back to previous page.

Base information Page

The base information will be switched by pressing "UP" or "DOWN" key. The selectable information is switched as below order:

Input voltage / Output voltage
Utility voltage is 230V, output voltage is 230V

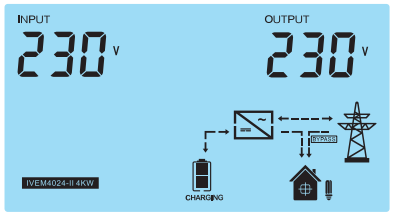

Input frequency / Output voltage
Utility frequency is 50.0Hz, output voltage is 230V

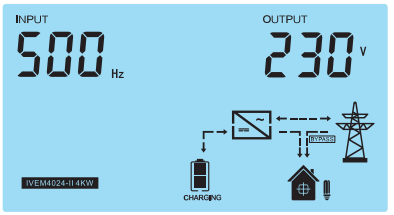

Battery voltage / Output voltage
Battery voltage is 24.0V, output voltage is 230V

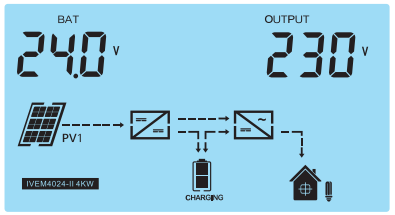

Charging current / Output voltage
Charging current is 10A, output voltage is 230V

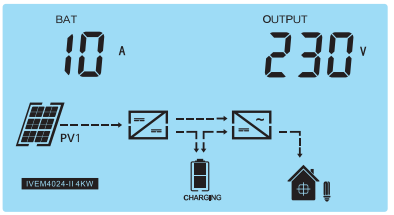

PV1 voltage
PV1 voltage is 360V

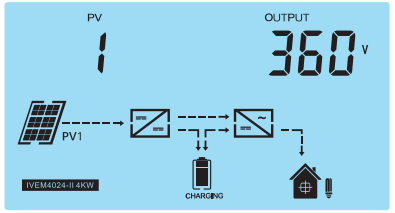

PV1 power
PV1 power is 3.00kW

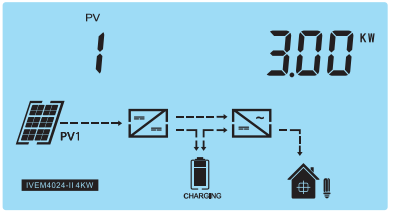

Battery voltage / Output frequency
Battery voltage is 24.0V, output frequency is 50.0Hz

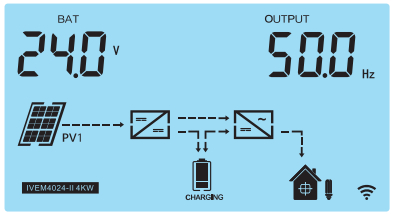

Battery voltage / Load percentage
Battery voltage is 24.0V, load percentage is 40%

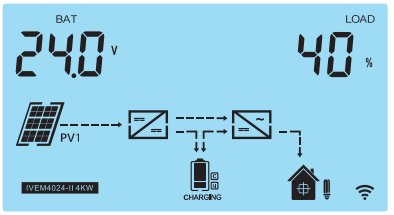

Battery voltage / Load VA
1. Battery voltage is 24.0V, output wattage is 2.00kVA

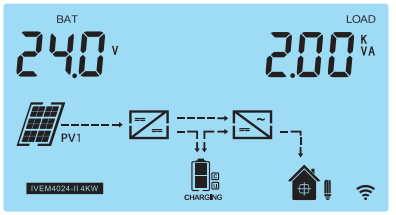

Battery voltage / Load wattage
Battery voltage is 24.0V output wattage is 2.00kW

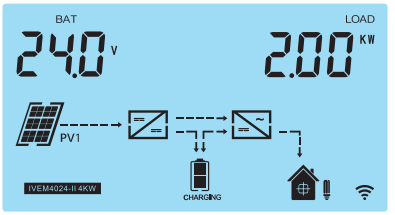

Battery voltage / Discharging current
Battery voltage is 24.0V, discharging current is 80A

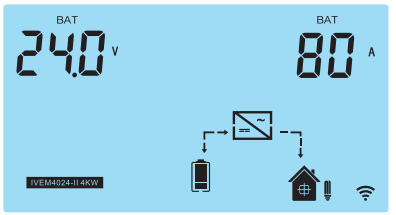

Generator voltage/generator power
Indicates the generator input 230V, input 2KW power

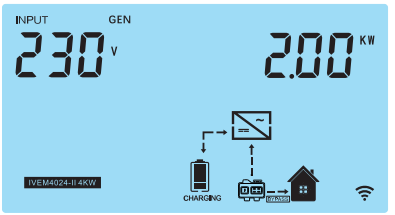

Generator frequency/Generator current
Indicates that the generator input frequency is 60HZ and the inputt current is 8.7A

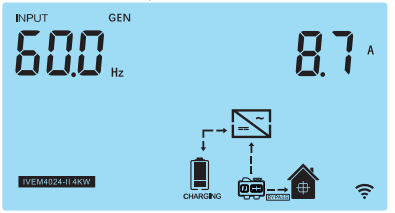

Smart load Voltage / Smart load power
Indicates that the smart load output 230V, output 2KW power

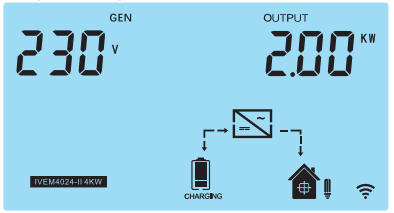

Smart load frequency/Smart lode current
Indicates that the Smart load output frequency is 60HZ and the output current is 8.7A

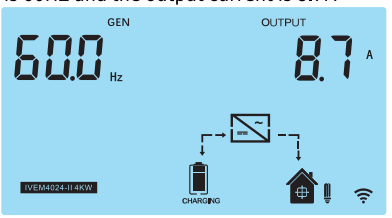

Date
2025-05-01

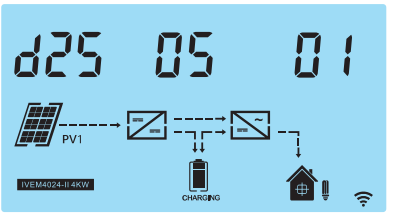

Time 09: 58: 55 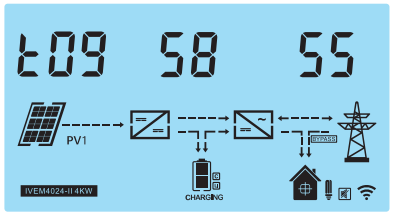	

Setting Page

Press "UP" or "DOWN" button to select setting programs. And then, press "ENTER" button to confirm the selection or ESC button to exit.

Setting items:

		Selectable option	
00	**Exit setting**		
01	**Output voltage setting**	**220V** 	Output voltage configuration
		230V 	
		240V 	
02	**Output frequency setting**	**50Hz** 	Output frequency configuration
		60Hz 	
03	**Utility input range setting**	**Appliance mode** 	APL should be selected, when the utility is not well.
		UPSmode 	

04	**Output source priority**	**Utility >> PV >>Battery** 	Utility provides power to the loads first. PV and battery will provide power to loads only when utility is not available.
		PV >> Utility >> Battery 	PV provides power to the loads first. If PV is not sufficient, utility will supply power the loads at the same time. Battery will provide power to loads only when utility is not available.
		PV >> Battery >> Utility 	PV provides power to the loads first. If PV is not sufficient, battery will supply power to the loads at the same time. Utility provides power to the loads only when battery voltage drops to the setting point in program 12.
05	**Charger priority**	**If inverter is working in utility mode, charger priority can be set as below. However, when inverter is working in Battery mode, only PV can charge battery.**	
		PV first (Default) 	PV will charge battery first. Utility will charge battery only when PV is unavailable.
		PV and Utility 	PV and utility will charge battery together.
		PV Only 	Only PV can charge the battery.
06	**Max charging current (Utility charge current + PV charging current)**	**Default: 60A** 	Setting range is from 10A to 120A. Increment of each click is 1A.
07	**Max utility charging current setting**	**Default: 30A** 	Setting range is from 10A to 100A. Increment of each click is 1A.

08	Battery type setting	The battery type is AGM  The battery type is Flooded  The battery type is self-defined  The battery type is Lib 	If “Self-defined” is selected, battery charge voltage and low DC cut-off voltage can be set up in program 9, 10 and 11. If “Lib” is selected, inverter can charge Lithium battery when the Lithium battery need to be activated. Please make sure Lithium battery is connected before you start up inverter. If inverter doesn’t connect battery or Lithium battery, do not select “Lib” battery type.
09	Bulk charging voltage setting (C.V voltage)	Default: 28.2V 	If "self-defined" is selected inprogram 8, this program is enabled. Setting range is from 24.0V to 30.0V. Increment of each click is 0.1V
10	Floating charging voltage	Default: 27.0V 	If “self-defined" is selected inprogram 8, this program is enabled. Setting range is from 24.0V to 30.0V. Increment of each click is 0.1V
11	Low DC cut-off voltage or Low SOC	**If battery power is only power source available, inverter will shut down. If PV energy and battery power are available, inverter will charge battery without AC output. If PV energy, battery power and utility are all available, inverter will transfer to line mode and provide output power to loads.**	
		Default: 21.0V 	"Self-defined" is selected in program 8, the range is set from 21.0V to 27.0V, with an increment of 0.1V per click.
		Default: 0% 	If "LIb" is selected in program 8, the range is set from 0% to 90%, with an increment of 5% per click.
12	Setting battery voltage point back to utility when selecting “SBU priority” in program 4	Default: 23.0V 	"Self-defined" is selected in program 8, the range is set from 22.0V to 27.0V, with an increment of 0.1V per click.
		Default: 10% 	If "LIb" is selected in program 8, the range is set from 5% to 95%, with an increment of 5% per click.

13	Setting battery voltage point back to battery mode when selecting “SBU priority” in program 4	Default: 27.0V 	"Flooded" or "Self-defined" is selected in program 8, the range is set from 24.0V to 30.0V, with an increment of 0.1V per click.
		Fully charged 	Battery should be charged to float charging stage.
		Default :30%(Lithium battery mode) 	If "LIb" is selected in program 8, the range is set from 10% to 100%, with an increment of 5% per click.
14	Overload bypass function	Disable (Default)  Enable 	If it is enabled, the inverter will switch to utility mode if overload happens in battery mode.
15	Overload restart function	Disable (Default)  Enable 	If it is enabled, the inverter will auto restart when overload occurs.
16	Over temperature restart function	Disable (Default)  Enable 	If it is enabled, the inverter will auto restart when over temperature occurs.
17	Backlight of LCD	Disable 	If selected, LCD backlight will be off after no button is pressed for 60s.
		Enable (Default) 	If selected, LCD backlight will be always-on.
18	Auto return to the first page of display screen	Disable 	If selected, the display screen will stay at latest screen user finally switches.
		Enable (Default) 	If selected, it will automatically return to the first page of display screen (Input voltage/ output voltage) after no button is pressed for 60s.

19	Buzzer Alarm	**Disable** 	If selected, buzzer is not allowed to beep.
		Enable (Default) 	If selected, buzzer is allowed to beep.
20	Feedback Power Enable	**Disable (Default)** 	If selected, the power feeding function will be turned off.
		Enable 	If selected, the power feeding function will be turned on.
21	Energy stored data for PV and Load	**Disable (Default)** 	If selected, inverter will esase all historical data of PV and Load energy, and stop record historical data for PV and Load energy.
		Enable 	If selected, inverter will record historical data for PV and Load energy. NOTE: Before selected, please double check if date and time is correct, if incorrect, please set date and time in program 22~27.
22	Time setting- Year	**Year** 	Setting rage is from 22 to 99.
23	Time setting- Month	**Month** 	Setting rage is from 1 to 12
24	Time setting- Day	**Day** 	Setting rage is from 1 to 31
25	Time setting- Hour	**Hour** 	Setting rage is from 0 to 23
26	Time setting- Minute	**Minute** 	Setting rage is from 0 to 59
27	Time setting- Second	**Second** 	Setting rage is from 0 to 59

Item 30 to 33 Sets the the smart load output interval. If the setting range is from 00:00 to 08:59, the smart load output will be turned on until 09:00. During this period, if the set value in item 34 or 35/36 is triggered, it will be turned off. (If the 34 time Settings work for 30 minutes, then 00:31, the the smart load output is off)

30	Start time setting-Hour	**Default : 0 hour** 	Setting rage is from 0 to 23.Increment of each click is 1 hour.
31	Start time setting-Minute	**Default : 0 minute** 	Setting rage is from 0 to 59.Increment of each click is 1 minute.
32	End time setting-Hour	**Default : 0 hour** 	Setting rage is from 0 to 23.Increment of each click is 1 hour.
33	End time setting-Minute	**Default : 0 minute** 	Setting rage is from 0 to 59.Increment of each click is 1 minute.
34	Setting discharge time on the smart load output if "Single" is s elected in program 28.	**Disable (Default)** 	Setting range is from 0 min to 990 min. Increment of each click is 5 minute. This item is disabled by default. 'dis' indicates disabled *If the battery discharge time achieves the setting time in program 30,31,32 and 33 and the program 35 or 36 function is not triggered, the output will be turned off.
35	Setting cut-off voltage point on the smart load output if "Single" is selected in program 28.	**Default :27V** 	If "User-defined" is selected in program 08, this setting range is from 21.0V to 27.0V for 24V model. Increment of each click is 0.1V.
36	Setting SOC percentage on the smart load output if "Single" is selected in program 28.	**Default : 60%** 	If "Lib" is selected in program 08, this parameter value will be displayed in percentage and value setting is based on battery capacity percentage. Setting range is from 0% to 95%. Increment of each click is 5%.
37	Turn on the second output when the inverter is back to Line Mode or Bypass Mode	**Disable** 	If selected, there is no effect on the second output When the inverter back to Line Mode or Bypass Mode
		Enable (Default) 	If selected, the output will turn on if second output is cut off due to setting in program 35 or 36

38	Reset Default	**Disable(default)** 	If selected, default initial Settings page.
		Enable 	If selected, Enable restores all Settings other than time to Default their initial values. The inverter also erases all energy storage-related historical data.
39	Record Fault Code	**Enable (Default)** 	If selected, recent fault records will be recorded, up to a maximum of 10 records
		Disable 	If selected, the machine will not record historical fault records.
40	Battery equalization	**If "Flooded" or "User-Defined" is selected in program 08, this program can be set up.**	
		Disable(default) 	If selected, the battery equalization function will be turned on.
		Enable 	If selected,the battery equalization function will be turned off.
41	Battery equalization voltage	**29.2V(default)** 	Setting range is from 24.0V to 31.0V. Increment of each dick is 0.1V
42	Battery equalized time	**60min(default)** 	Setting range is from 5 min to 900 min. Increment of each dick is 5 min.
43	Battery equalized timeout	**120min(default)** 	Setting range is from 5 min to 900 min. Increment of each dick is 5 min.
44	Equalization interval	**30days(default)** 	Setting range is from 0 to 90 days. Increment of each click is 1 day
45	Equalization activated immediately	**Disable(default)** 	If "Disable" is selected, it will cancel equalization function until next activated equalization time arrives based on program 44," Eq"wil not be shown in LCD main page.
		Enable 	If equalization function is enabled in program 40, this program canbe set up. If "Enable" is selected in this program, it's to activate battery equalization immediately and LCD main page will shows"Eq".

48	Max Discharging Current	**Default:165A** 	If the battery type is non lithium and"SBU" is selected in program 04, this setting will take effect, In battery mode, if the battery current reaches the set value, the machine will switch to utility mode. Setting range is from 10A to 165A. Increment of each click is 1A.
50	Feedback power setting	**4.0KW(default)** 	Setting range is from 0.5 KW to 4 KW. Increment of each dick is 0.1KW.
51	Island Detection	**Disable(default)** 	If selected, the Island detection function will be turned off.
		Enable 	If selected, the Island detection function will be turned on.

Energy stored data Page

The energy stored data will be switched by pressing "UP" or "DOWN" key. The selectable information is switched as below order:

PV generated energy today
99 kWh

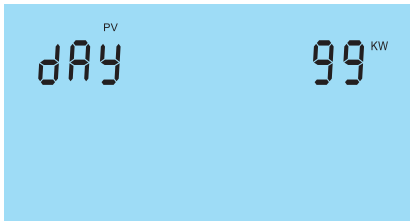

PV generated energy this month
99 kWh

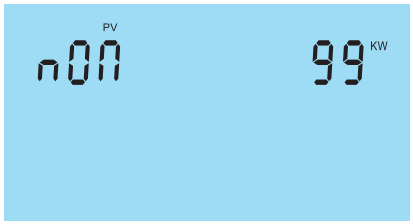

PV generated energy this year
99 kWh

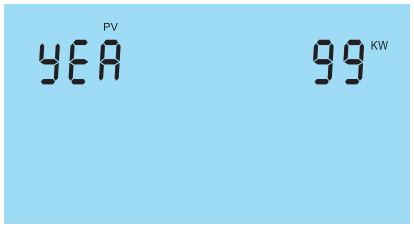

PV generated energy current in total
340 kWh

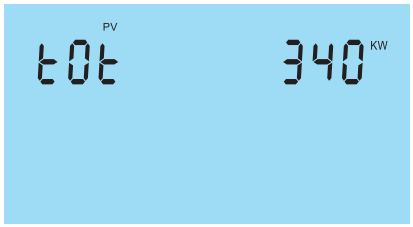

Load consumed energy today
79 kWh

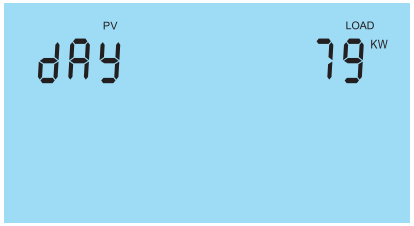

Load consumed energy this month
79 kWh



Load consumed energy this year
80 kWh

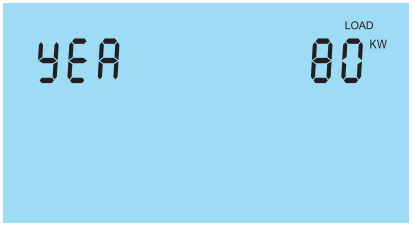

Load consumed energy in total
272 kWh

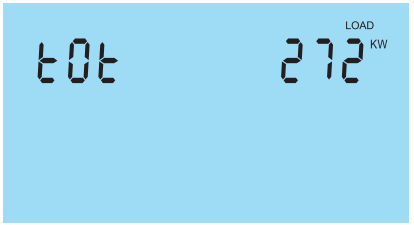

BMS information Page

The BMS information will be switched by pressing "UP" or "DOWN" key. The selectable information is switched as below order:

Mean SOC/ Battery pack number / BMS status **PV generated energy this month**
Mean SOC is 97%, Connected Battery pack number is 4, BMS status is 51 (Check detail in warning code table). If BMS status occurred, it will be rolled with battery pack number automatically.

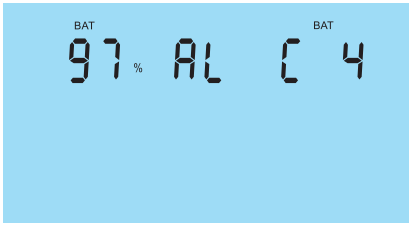

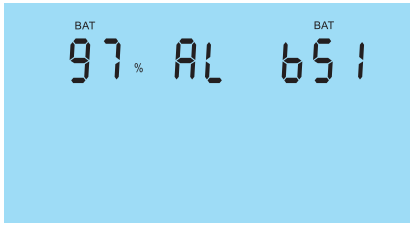

BMS version / SOC
BMS version is 100, SOC is 99% on battery pack of address 1

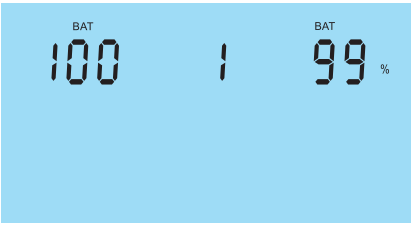

BMS voltage / current
BMS voltage is 27.0V, current is 1A on battery pack of address 1

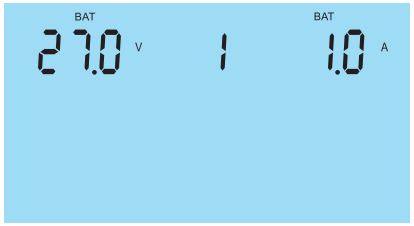

BMS highest temerpature / lowest temerpature
BMS highest temerpature is 25°C , lowest temerpature is -10°C on battery pack of address 1

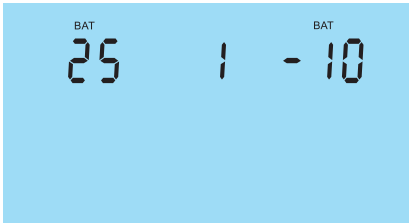

BMS fault code / flag
BMS fault code is 0, flag is 000 on battery pack of address 1

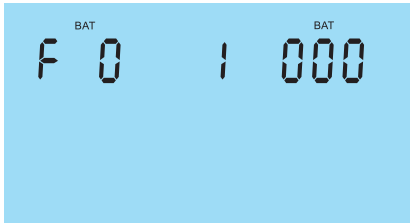

Rated information Page

The rated information will be switched by pressing "UP" or "DOWN" key. The selectable information is switched as below order:

Rated VA / WATT
Rated VA is 4KVA, WATT is 4KW

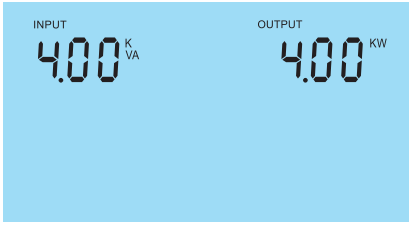

Rated battery voltage / Max. charge current
Rated battery voltage is 24V, Max. charge current is 100A

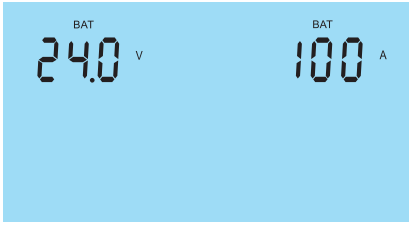

Firmware version
Firmware version is 300

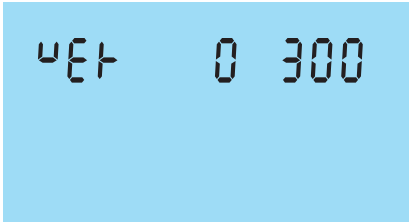

Generator Port Use Setup Page

Press "UP" or "DOWN" button to select setting programs. And then, press "ENTER" button to confirm the selection or ESC button to exit.

Setting items:

		Selectable option	
00	**Exit setting**		
01	**Generator and smart load switching**		The generator port can be switched to the smart load port, the default is the generator port "GEN". If you want to switch, first turn off the inverter switch so that the inverter is in standby state, and then switch to "SLd" when entering the interface.
			

02	**Generator charging enable**		This option is used by default, if you choose not to use, the generator cannot be charged
			
03	**Generator charging power setting**		Press the "ENTER" key each time to select the value to change; Use the "UP" key to decrease the value and the "DOWN" key to increase the value The maximum setting value is 50KW and the minimum setting value is 0.5KW Default value is 4KW

Lithium Battery Communication

It's allowed to connect lithium battery and build communication only which it has been configured.
Please follow bellow steps to configure communication between lithium battery and inverter.

1. Connect power cables between lithium battery and inverter. Please pay attention to the terminals of positive and negative. Make sure the positive terminal of battery is connected to the positive terminal of inverter, and the negative terminal of battery is connected to the negative terminal of inverter.
2. The communication cable is bundled with lithium battery. Both sides are RJ45 port. One port is connected to the BMS port of inverter and another one is connected to the COMM port of lithium battery.

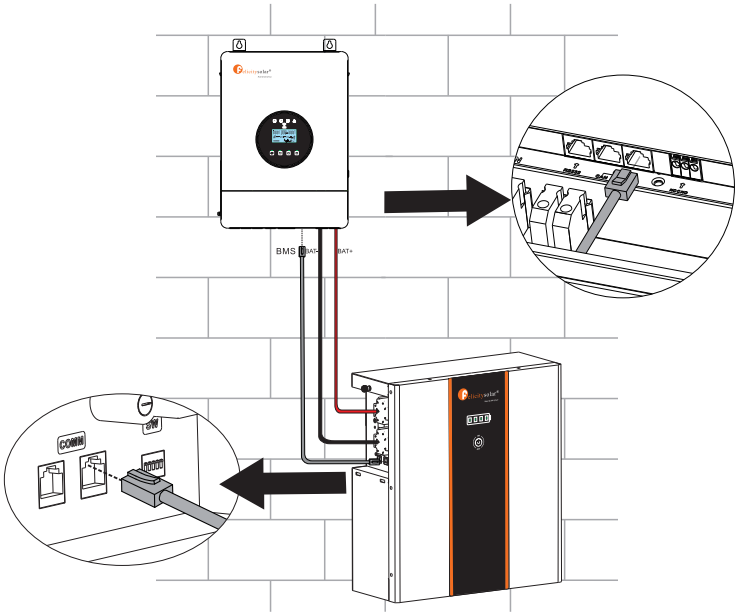

Pin Assignment for BMS Communication Port

	BMS	
PIN 1	NC	
PIN 2	NC	
PIN 3	CAN.L	
PIN 4	CAN.H	
PIN 5	RS485-B	
PIN 6	RS485-A	
PIN 7	NC	
PIN 8	NC	



3. Configure battery type to “Lib” in LCD setting No. 08.

The battery type is Lib



And then LCD will show you “Li” icon.

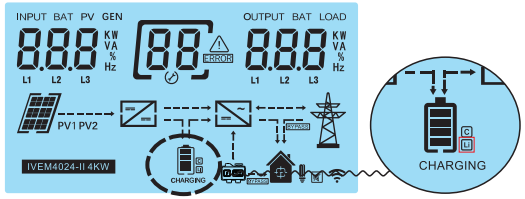

4. Power up lithium battery and inverter. Wait a moment, if the communication is built between them, LCD will show you “C” icon as below.

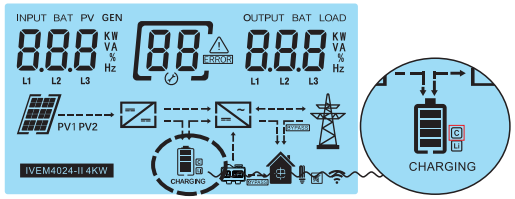

5. Roll LCD real time information pages by pressing “UP” or “DOWN” button, as below page, you can see the parameters of SOC and battery pack units in the communication system.

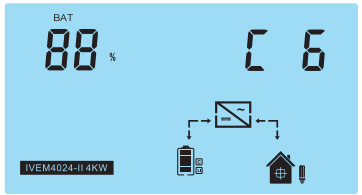

This page means SOC is 88% and battery pack units are 6.

Battery Equalization

Battery equalization function is built into the charge controller.It mitigates the formation of negative chemical impacts like stratification, a condition where the acid concentration is greater at the bottom of the battery than at the top.
Equalization neutralizes the formation of sulfate crystals that might have accumulated on the plates. If left unchecked, this condition is called sulfation and can reduce the total capacity of the battery, Therefore, it is recommended to balance the battery regularly.

• How to Apply Equalization Function

You must enable battery equalization function in the monitoring LCD setup program 40 at the beginning. Then, you can apply this function to the device in one of the following ways:
1. Setting equalization interval in program 44.
2. Active equalization immediately in program 45.

• When to Equalize

During the floating charge stage, when the set equalization interval (battery equalization cycle) is reached, or when equalization is initiated immediately, the controller will begin to enter Equalize Mode.

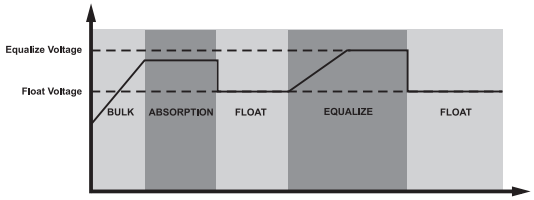

• Equalize charging time and timeout

In Equalize Mode, the controller will charge the battery with as much power as possible until the battery voltage rises to the battery equalization voltage. Then, constant-voltage regulation is performed to keep the battery voltage at the battery equalization voltage. The battery will remain in the Equalize stage until the set battery equalization time is reached.

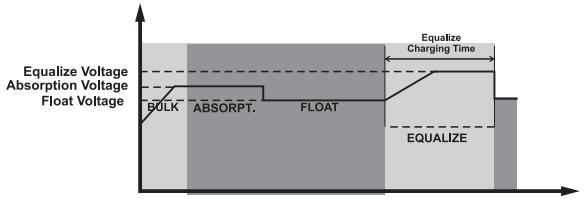

However, in Equalize Mode, when battery equalized time has passed and the battery voltage has not risen to the battery equalization voltage point, the charge controller will extend the battery equalization time until the battery voltage reaches the battery equalization voltage. When battery equalized timeout setting is complete, if the battery voltage is still lower than the battery equalization voltage, the charge controller will stop the balancing and return to the float stage.

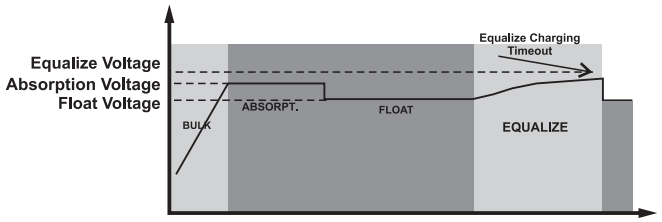

Warning Code Table

When fault event happens, the fault LED is flashing. At the same time, warning code, icon ⚠ is shown on the LCD screen.

Warning Code	Warning Information	Audible Alarm	Trouble Shooting
01	Fan is locked.	Beep three times every second	Check if the Fans wiring connected well. Replace the fan.
02	Overload	Beep twice every second	Reduce the loads.
03	Low battery	Beep once every second	The battery voltage is too low, it should be charging.
50	BMS firmware version is not matched.		Upgrade the firmware of BMS.
51	BMS doesn't allow inverter to charge battery.		Inverter will stop charging battery automatically.
52	BMS doesn't allow inverter to discharge battery.		Inverter will stop discharging battery automatically.
53	BMS require inverter to charge battery.		Inverter will charge battery automatically.
54~65	BMS detect something wrongs happened.		If the code is keeping for long time, please contact with your installer.
80	BMS communication fault		Check if the communication line is connected well.
Eq	Battery equalization	/	/

Fault Code Table

When fault event happens, inverter will cut off output, and the fault LED is solid on. At the same time, fault code, icon ⚠ and ERROR are shown on the LCD screen.

Fault Code	Fault information	Trouble Shooting
01	Bus voltage is too high	AC Surge or internal components failed. Restart the unit, if the error happens again, please return to repair center.
02	Bus voltage is too low	Restart the unit, if the error happens again, please return to repair center.
03	Bus soft start fail	Internal components failed. Restart the unit, if the error happens again, please return to repair center.
04	Inverter soft start fail	Internal components failed. Restart the unit, if the error happens again, please return to repair center.
05	Over current or surge detected by Software	Restart the unit, if the error happens again, please return to repair center.
06	Over current or surge detected by hardware	Restart the unit, if the error happens again, please return to repair center.
07	Output voltage is too low	Reduce the connected load. Restart the unit, if the error happens again, please return to repair center.
08	Output voltage is too high	Restart the unit, if the error happens again, please return to repair center.
09	Output short circuited	Check if wiring is connected well and remove abnormal load.
10	Overload time out	Reduce the connected load by switching off some equipment.
11	Battery voltage is too high	Check if spec and quantity of batteries are meet requirements.
12	Over current happen at DCDC circuit	Restart the unit, if the error happens again, please return to repair center.
13	PV voltage is too high	Reduce the number of PV modules in series.
14	Short circuited happen at PV port	Check if wiring is connected well.
15	PV power is abnormal	Reduce the number of PV modules.
16	Over current happen at PV port	Restart the unit, if the error happens again, please return to repair center.
17	Fan is locked	Check if wiring is connected well. Replace the fan.
18	Over temperature happen at PV circuit	The temperature of internal PV converter component is over the limitation. Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.

19	Over temperature happen at battery circuit	The temperature of internal battery converter component is over the limitation. Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.
20	Over temperature happen at inverter circuit	The temperature of internal inverter component is over the limitation. Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.
21	The inner temperature over	The inner temperature is over the limitation. Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.
22	DCDC current sensor failed	Restart the unit, if the error happens again, please return to repair center.
23	No.2 DCDC current sensor failed	Restart the unit, if the error happens again, please return to repair center.
24	Inverter current sensor failed	Restart the unit, if the error happens again, please return to repair center.
25	OP current sensor failed	Restart the unit, if the error happens again, please return to repair center.
26	Sharing current sensor failed	Restart the unit, if the error happens again, please return to repair center.
27	The AC input and output wires are inversely connected	1. Please check AC input and output wires are connected correctly. 2. If this error happens during parallel installation, please check wires connection. If they are connected correctly, please funish parallel installation first, and then restart inverters. 3. If the problem remains, please contact your installer.
28	Single unit is installed to parallel system	1. Please check if single unit is installed to parallel system. 2. If this error happens during parallel installation, please check wires connectiotn. If they are connected correctly, please funish parallel installation first, and then restart inverters. 3. If the problem remains, please contact your installer.
29	DC/DC soft start fail.	Restart the unit, if the error happens again, please return to repair center.
31	Over temperature happen at convert H circuit	The temperature of internal convert H component is over the limitation. Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.
32	Over temperature happen at LLC TX	The temperature of internal DC/DC TX is over the limitation. Check whether the air flow of the unit is blocked or whether the ambient temperature is too high.
33	Over current happen at LLC circuit	Restart the unit, if the error happens again, please return to repair center
34	DCDC Over current detected by hardware	Restart the unit, if the error happens again, please return to repair center.

34	DCDC Over current detected by hardware	Restart the unit, if the error happens again, please return to repair center.
35	Overvoltage occurs in BUS	AC surge or PV surge or internal components failed. Restart the unit, if the error happens again, please return to repair center.
40	CAN data loss	1. Check if communication cables are connected well and restart the inverter. 2. If the problem remains, please contact your installer.
41	Host data loss	
42	Synchronization data loss	
43	Current feedback into the inverter is detected.	1. Restart the inverter. 2. Check if L/N cables are not connected reversely in all inverters. 3. For parallel system in single phase, make sure the sharing cables are connected in all inverters. For supporting three-phase system, make sure the sharing cables are connected in the inverters in the same phase, and disconnected in the inverters in different phases. 4. If the problem remains, please contact your installer.
44	The firmware version of each inverter is not the same.	1. Update all inverter firmware to the same version. 2. Check the version of each inverter via LCD setting and make sure the CPU versions are same. If not, please contact your installer to provide the firmware to update. 3. After updating, if the problem still remains, please contact your installer.
45	The output current of each inverter is different.	1. Check if sharing cables are connected well and restart the inverter. 2. If the problem remains, please contact your installer.
46	AC output mode setting is different.	1. Switch off the inverter and check LCD setting program 28. 2. For parallel system in single phase, make sure no 3P1, 3P2 or 3P3 is set on program 28. For supporting three-phase system, make sure no “PAL” is set on program 28. 3. If the problem remains, please contact your installer.
47	Generator current sensor failed	Restart the unit, if the error happens again, please return to repair center.
48	PV Over current detected by hardware	Restart the unit, if the error happens again, please return to repair center.
60	SPS start fail	Restart the unit, if the error happens again, please return to repair center.
61	PV to ground insulation test failed	Restart the unit, if the error happens again, please return to repair center.

The Wi-Fi operation Guide in APP

Introduction

Wireless communication between the off-grid inverter and the APP can be realized through the Wi-Fi module.The APP supports Android and iOS devices.

Delivers device status during normal operation.
Allows device Settings to be configured on the APP.
Notifies users when a warning or alarm occurs.
Allows users to query inverter history data.

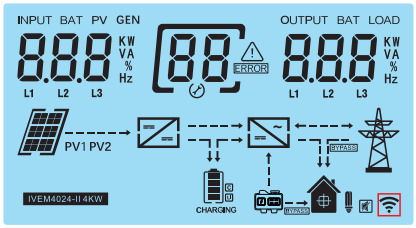

The status of the Wi-Fi sign on the LCD display
After the APP is successfully connected,Wi-Fi indicator light remains constantly on

Download and install APP

Operating system requirement for your smart phone:

iOS system supports iOS 11.0 and above

Android system supports Android 5.0 above

APP Download
Please scan the following QR code with your smartphone to download the App.

The QR code supports Android system and iOS system

Operation Manual
Please scan the following QR code with your smartphone to view the App Operation Manual

The QR code supports Android system and iOS system